




Pacific Gas and
Electric Company


Lake Almanor - 2003, 2004, 2005 & Projected 2006 Elevation

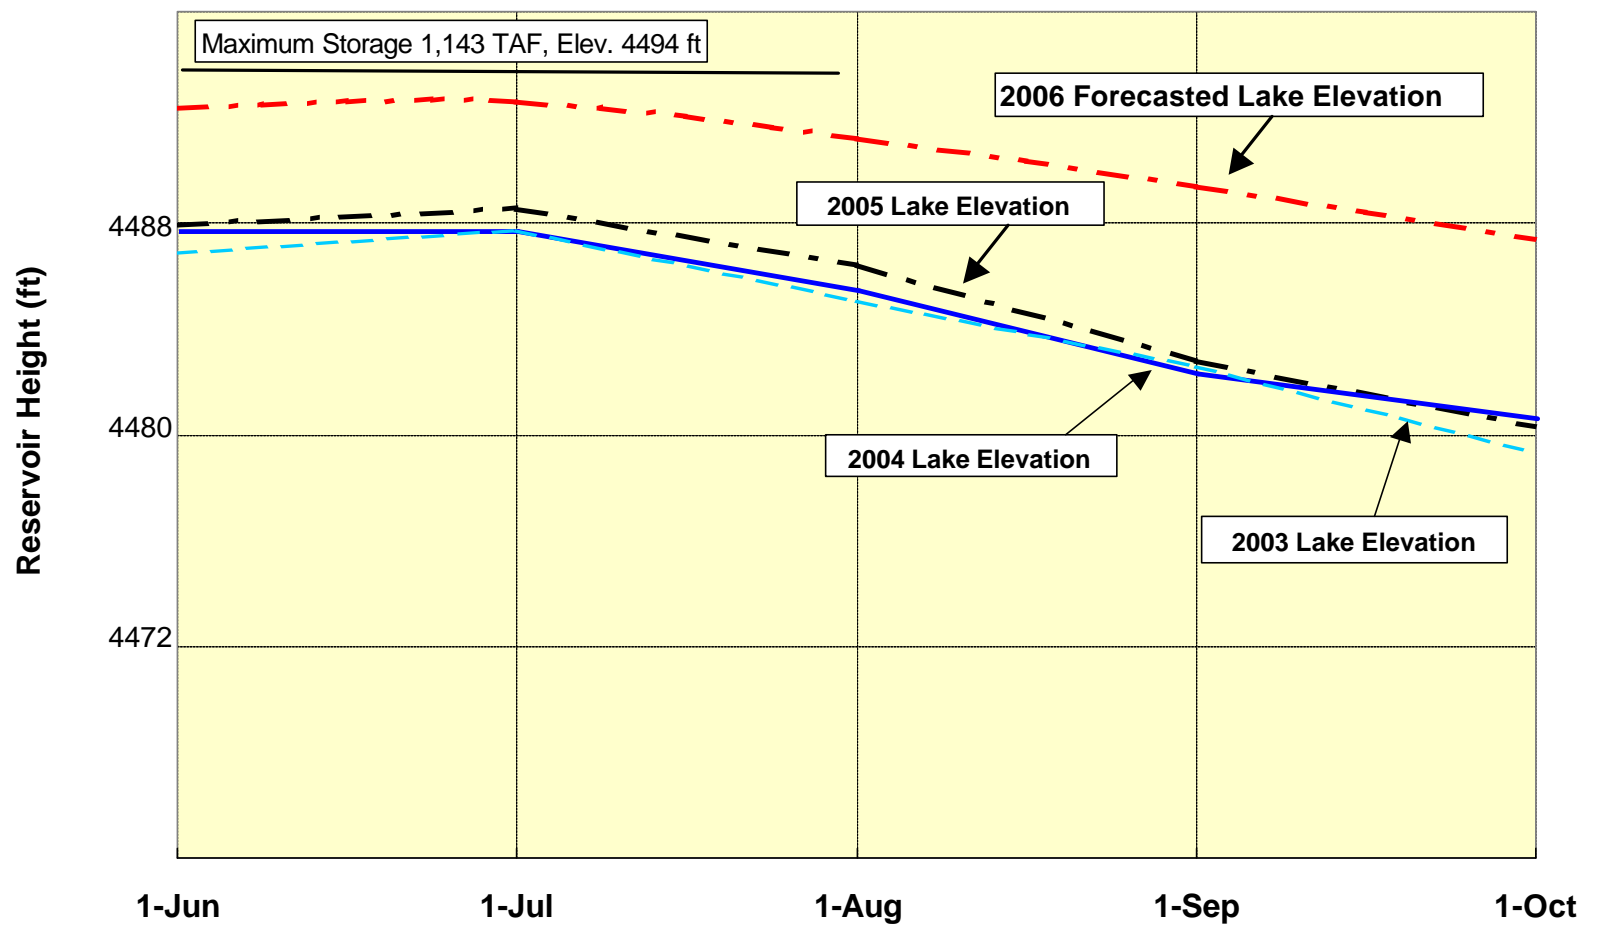

PG&E Water Mgt.
tag Apr 2006

July 1, 2005 thru April 25, 2006

Percent of mean monthly Precipitation (1976-2005) for 2 No Fk Feather River Stations*

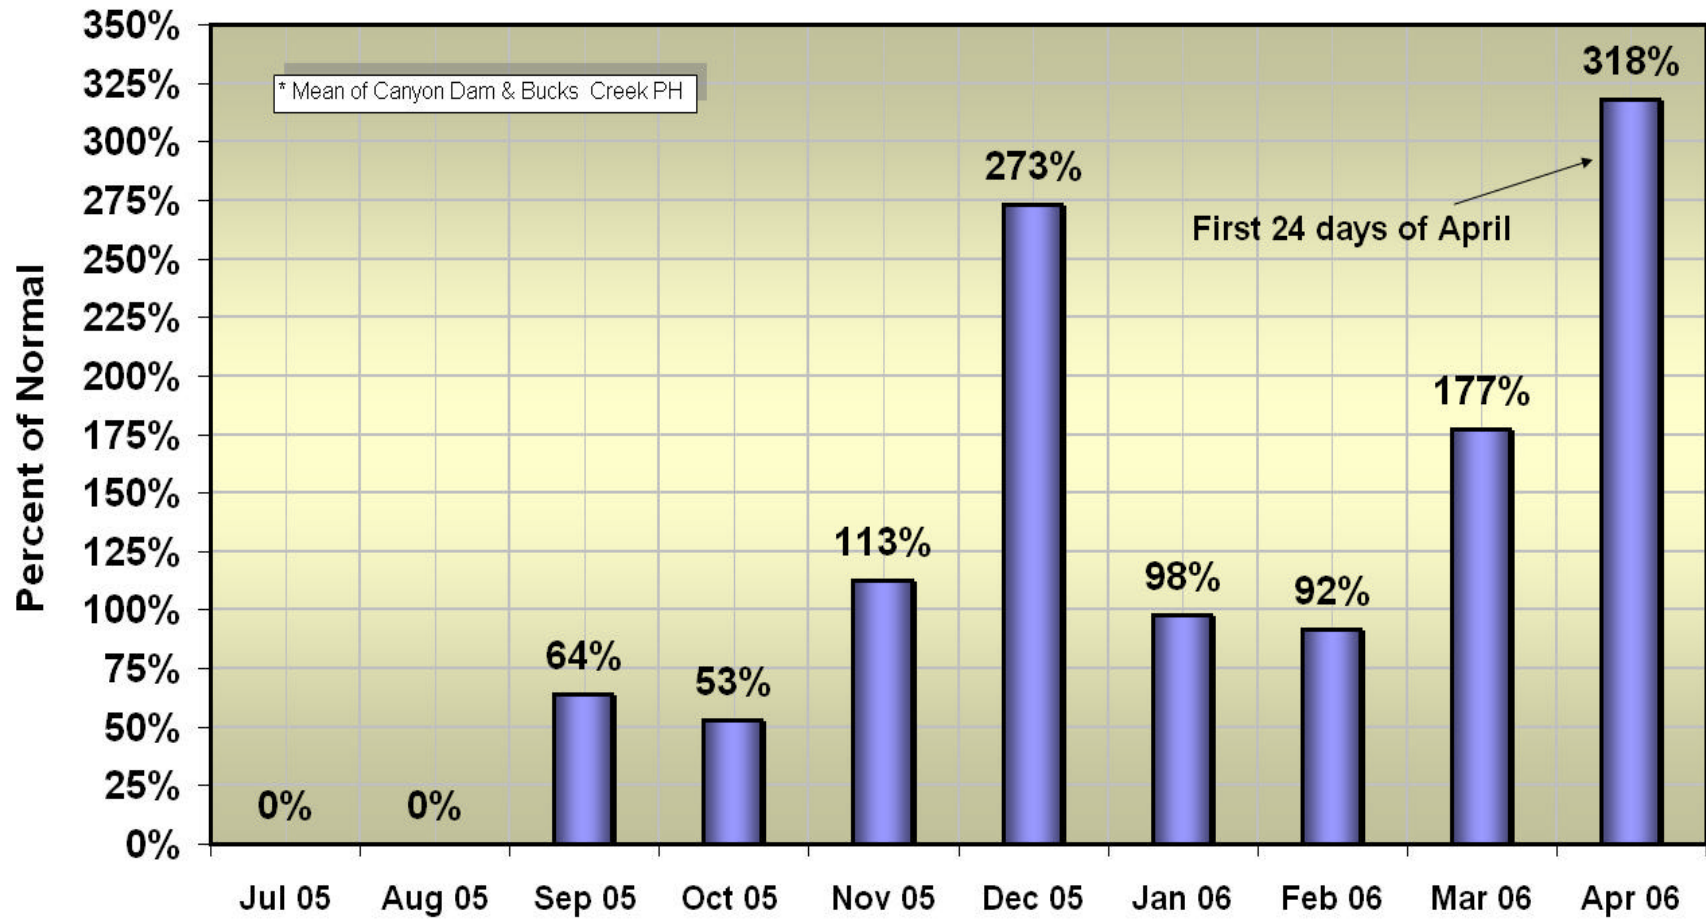

Special Test Schedule

Sequential Day #s	Canyon Dam Discharge	Prattville/BV PH Discharge	Caribou #1 Discharge	Caribou #2 Discharge
1 - 4	90 cfs	Insync w/ Caribou #2	OFF until the special test	on/off 8 hrs
5 - 11	120 cfs	Insync w/ Caribou #2	130 cfs	on/off 8 hrs
12 - 16	120 cfs	Insync w/ Caribou #2	130 cfs	on/off 11 hrs
17 - 23	120 cfs	Insync w/ Caribou #2	480 cfs	on/off 8 hrs
24 - 28	35 cfs	500 cfs	no restrictions	no restrictions


Note:

- 1) Study one to occur between approximately July 15, 2006 and August 15, 2006
- 2) Caribou #1 PH must be OFF during the spring months preceding the special test to preserve the cold water pool in Butt Valley Reservoir (Caribou #1 will be shut down when water temperature at 4113 ft (USGS datum) reaches 17 degrees Celsius or June 1, which ever is first)
- 3) The duration of the reduced Butt Valley PH discharge test will be determined based on the Butt Valley CE-QUAL-W2 preliminary model testing



Pacific Gas and
Electric Company

Bucks Lake - 2003, 2004, 2005 & Projected 2006 Elevation

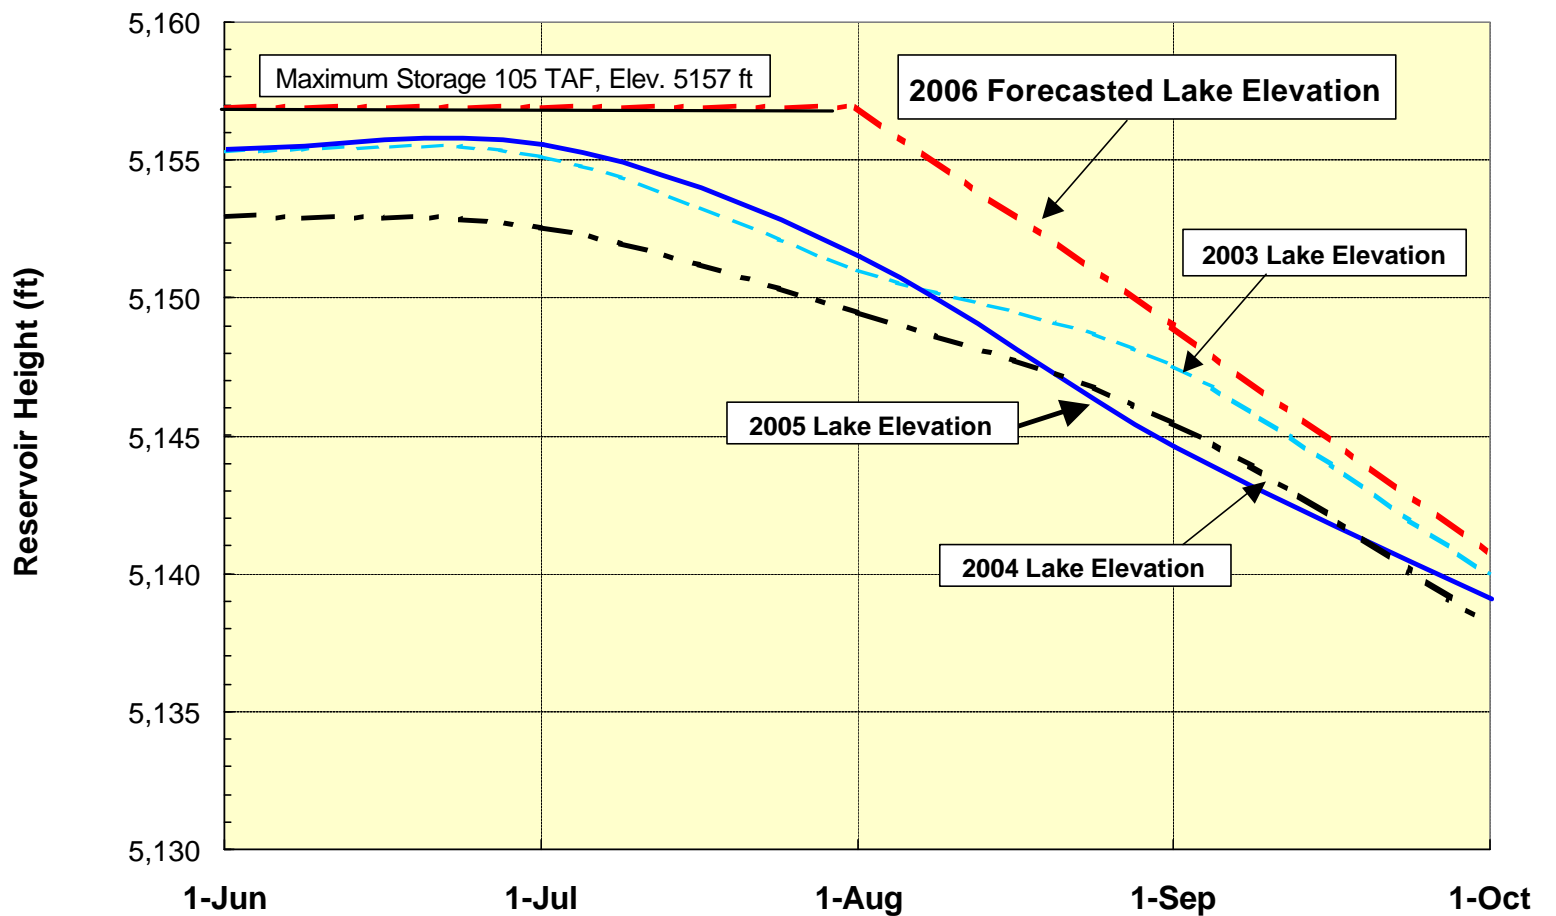

PG&E Water Mgt.
tag Apr 2006